


<u>DIMENSION A</u>	<u>TRANSFORMER KVA</u>	<u>BUILDING WALL & EAVES</u>
10'	0-75	NOT FIRE RESISTANT
20'	76-333	NOT FIRE RESISTANT
30'	334 AND LARGER	NOT FIRE RESISTANT
3'	ALL SIZES	FIRE RESISTANT (8" BRICK, ETC.)

ELEVATION VIEW

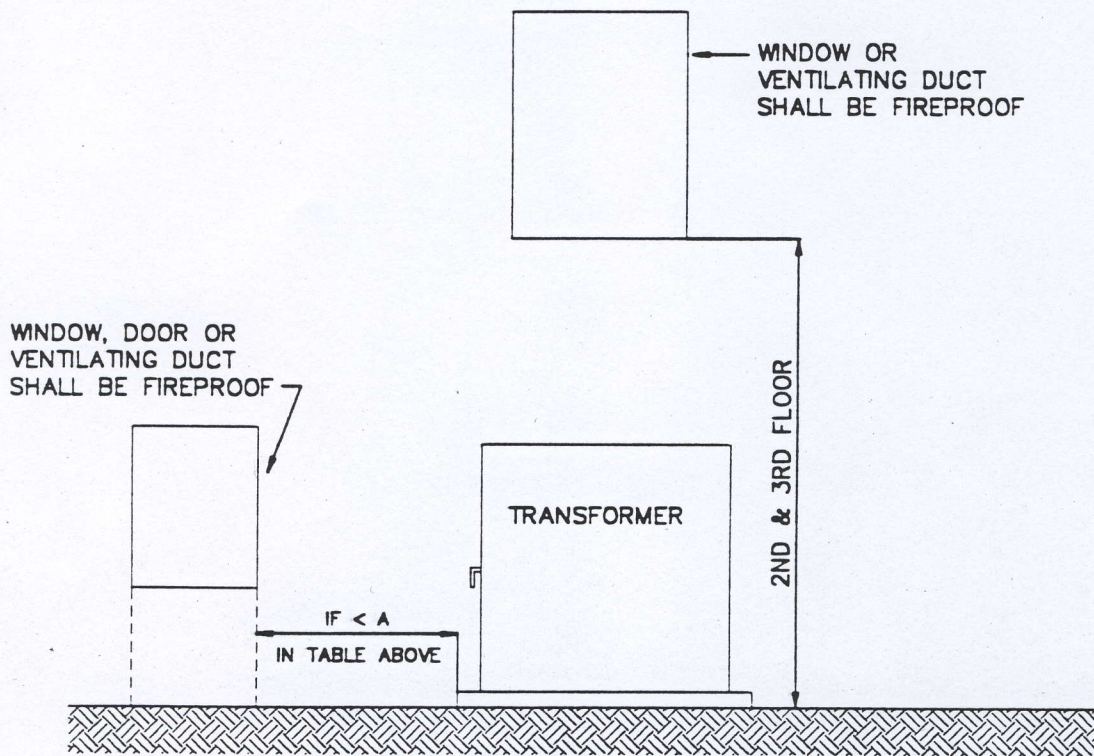

ELEVATION VIEW

TENNESSEE VALLEY PUBLIC POWER ASSOCIATION	TYPICAL SITING REQUIREMENTS FOR PAD-MOUNTED TRANSFORMER	DATE: 10-22-92
		STANDARD NUMBER UMT-1